

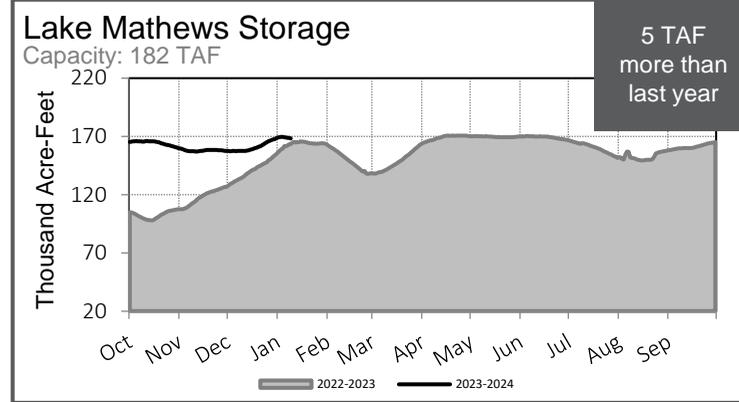


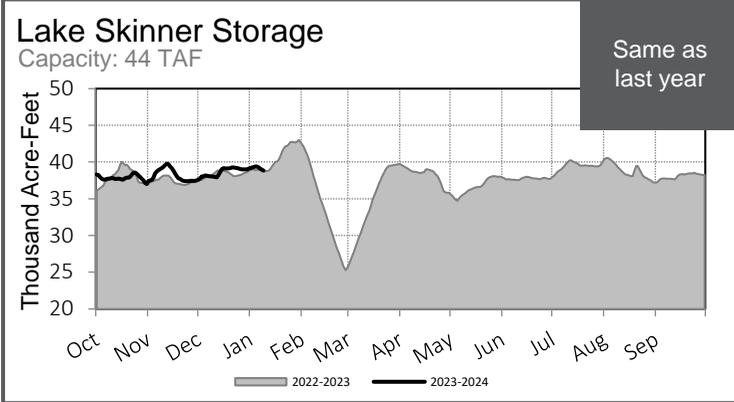

2024 SWP Table A – 10% - 191,150 AF

Projected 2023 CRA Diversions – 652,000 AF


## Metropolitan Resources

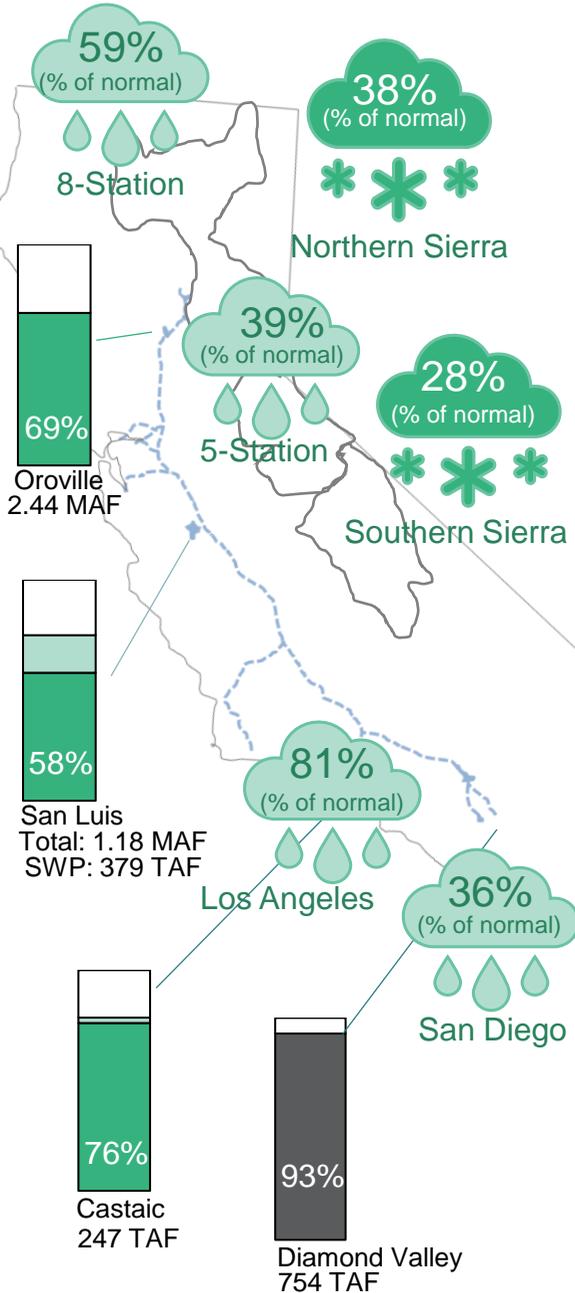

### MWD WSDM Storage

Calendar Year 2024

	Take Capacity (2024)
Lake Mead ICS	147,000 acre-feet
State Water Project System	593,000 acre-feet
In-Region Supplies and WSDM Actions	633,000 acre-feet

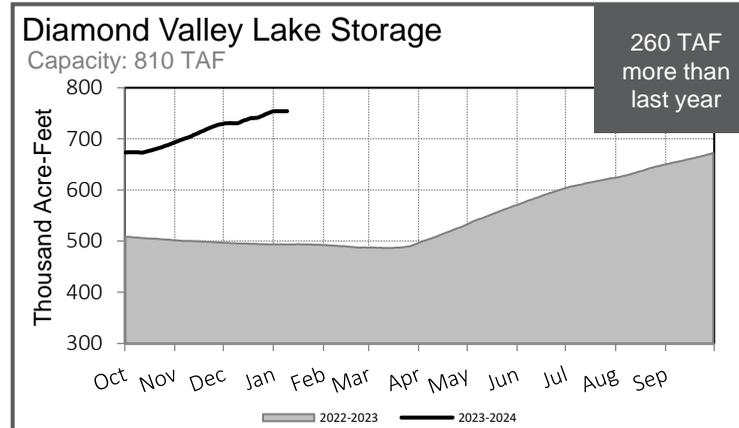

## Highlights

Learn more about imported supplies:

- State Water Project - <https://www.mwdh2o.com/state-water-project-map/>
- Colorado River Aqueduct - <https://www.mwdh2o.com/colorado-river-aqueduct-map/>




This report is produced by the Water Resource Management Group and contains information from various federal, state, and local agencies. The Metropolitan Water District of Southern California cannot guarantee the accuracy or completeness of this information. Readers should refer to the relevant state, federal, and local agencies for additional or for the most up to date water supply information. Reservoirs, lakes, aqueducts, maps, watersheds, and all other visual representations on this report are not drawn to scale. Questions? Email mferreira at mwdh2o dot com


# State Water Project Resources

As of: 01/09/2024


## Northern Sierra Snowpack

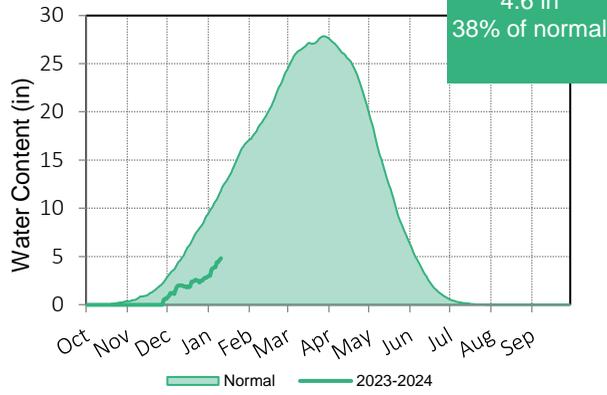


## 8 Station Index Precipitation

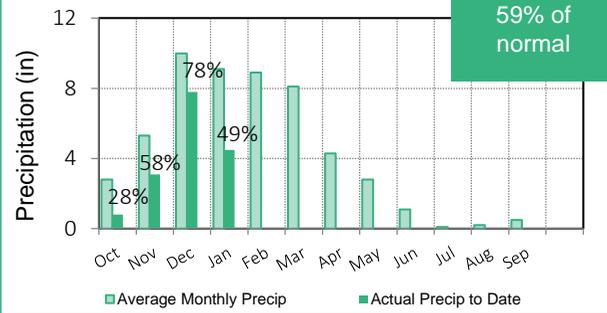

## Oroville Reservoir Storage

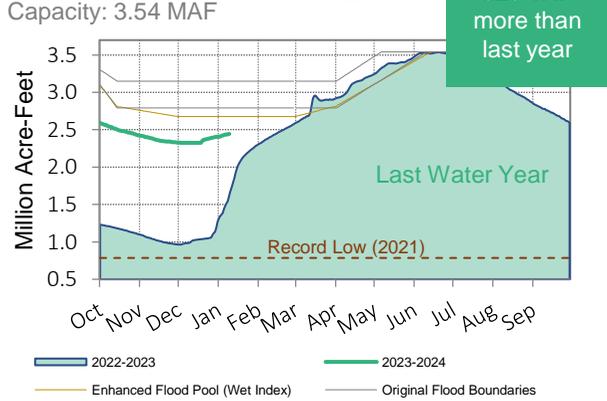

## Sacramento River Runoff

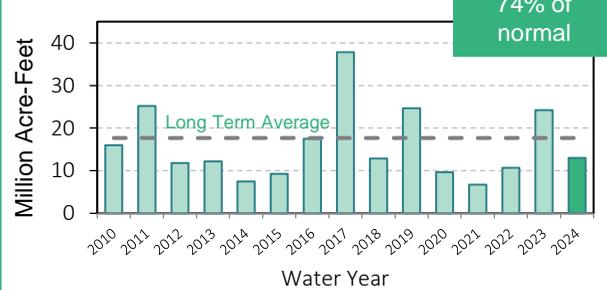


## Other SWP Supplies


Calendar Year 2024

Carryover 200,000 acre-feet

## San Luis Reservoir Storage

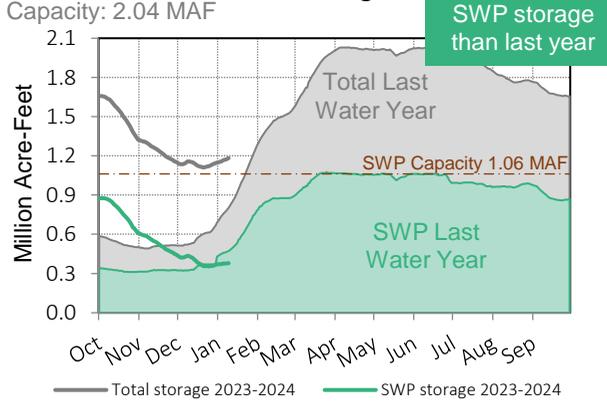


## 5 Station Index Precipitation

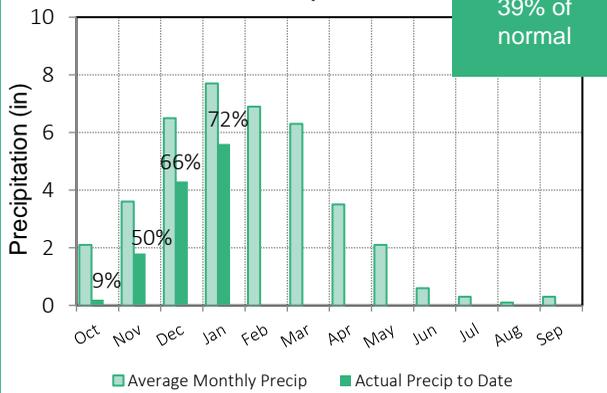


# Colorado River Resources

As of: 01/09/2024


## Upper Colorado Precipitation

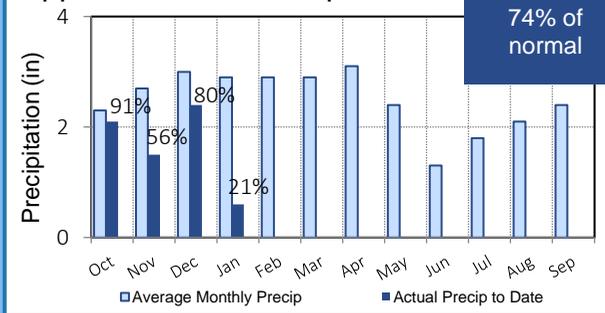


## Upper Colorado Snowpack

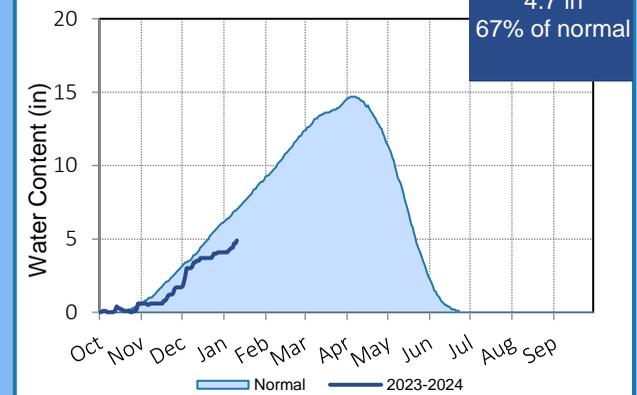

## Powell Unregulated Inflow

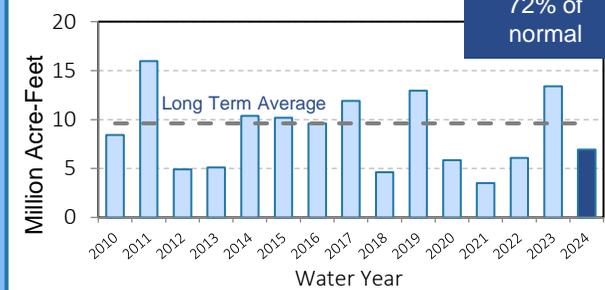

## Lake Powell Storage

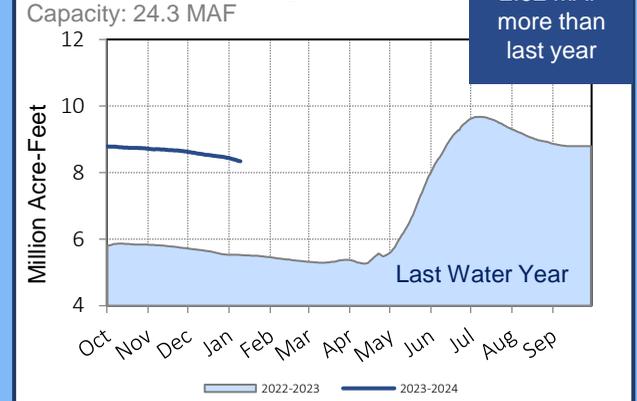

## PVID/Yuma Agricultural Use

Annual Forecasted for 2024

Forecasted Use for 2024: TBD

## Projected Lake Mead ICS

Calendar Year 2024

Put (+) / Take (-) TBD

## Lake Mead Surplus/Shortage Outlook

	2024	2025	2026
Surplus	0%	0%	0%
Shortage	100%	93%	77%
Metropolitan DCP*			20% 195 TAF

Likelihood based on results from the August 2023 CRMMs in Ensemble Model/CRSS model run. Includes DCP Contributions.  
\* Chance of required DCP contribution by Metropolitan. Volume is average contribution when needed.

## Lake Mead Storage

