

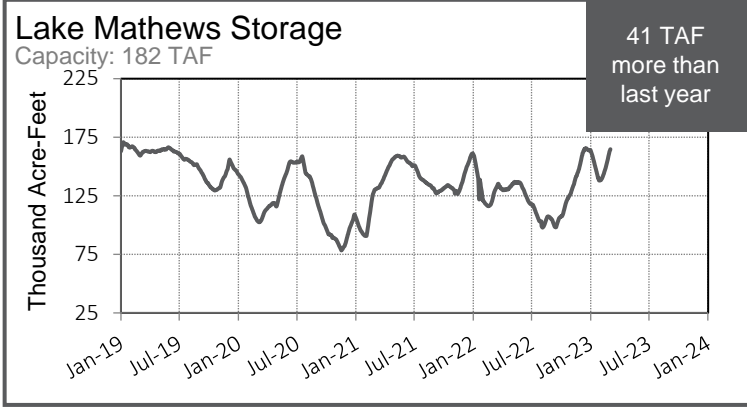


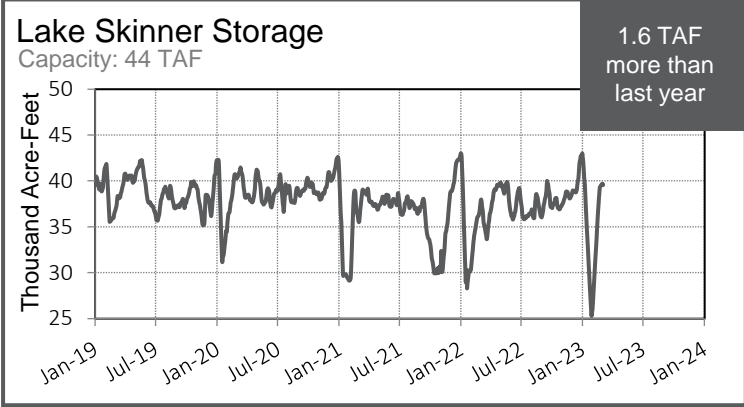

SWP Table A – 75% - 1,433,625 AF


Projected CRA Diversions – 991,000 AF

Metropolitan Resources

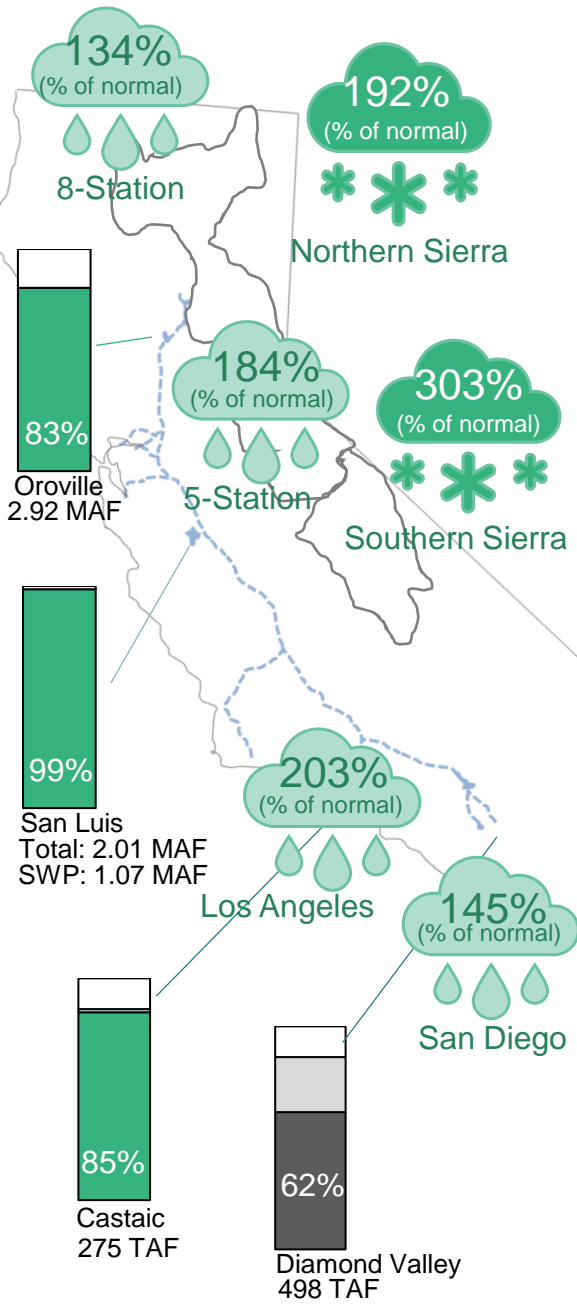

MWD WSDM Storage
Calendar Year 2023

	2023 Take Capacity
Colorado River Aqueduct Delivery System	TBD
State Water Project System	158 TAF
In-Region Supplies and WSDM Actions	329 TAF
Other Programs	40 TAF
Total WSDM Projected Storage Take	527 TAF

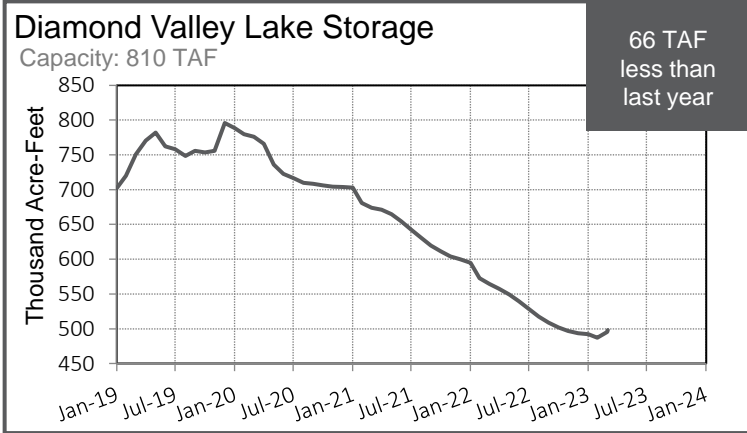

Highlights

- SWP share of San Luis Reservoir is full and DWR is making Article 21 – Interruptible Water Service available
- April 1 snowpack at Northern Sierra was 58.5 inches or 190% of normal
- April 1 snowpack at the Upper Colorado River Basin was 23.1 inches or 157% of normal




This report is produced by the Water Resource Management Group and contains information from various federal, state, and local agencies. The Metropolitan Water District of Southern California cannot guarantee the accuracy or completeness of this information. Readers should refer to the relevant state, federal, and local agencies for additional or for the most up to date water supply information. Reservoirs, lakes, aqueducts, maps, watersheds, and all other visual representations on this report are not drawn to scale. Questions? Email mferreira@mwdh2o.com


State Water Project Resources

As of: 04/02/2023


Northern Sierra Snowpack

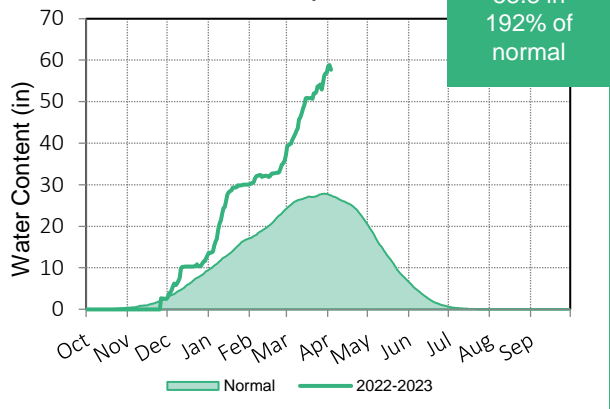


8 Station Index Precipitation

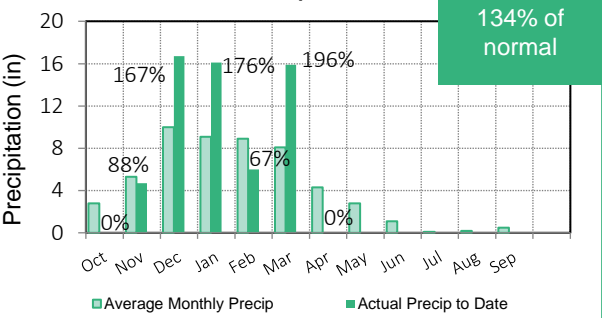

Oroville Reservoir Storage

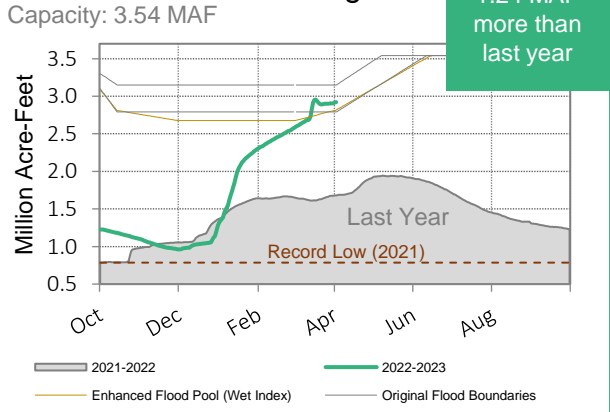


Sacramento River Runoff

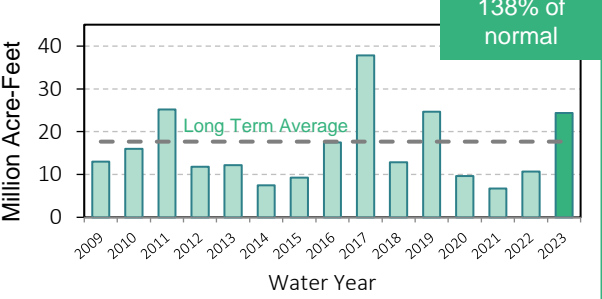


Other SWP Supplies

Calendar Year 2023	
Carryover	39,000 acre-feet
Article 21	83,000 acre-feet

San Luis Reservoir Storage

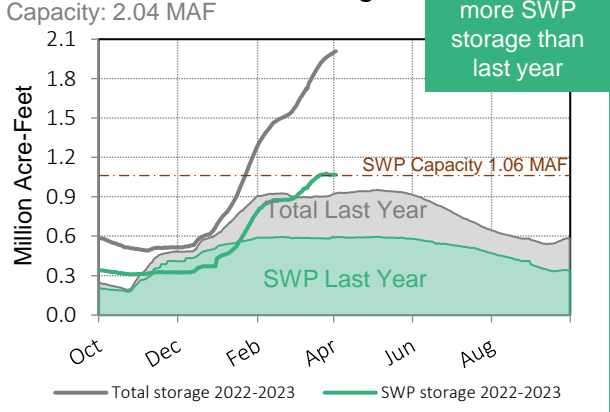


5 Station Index Precipitation

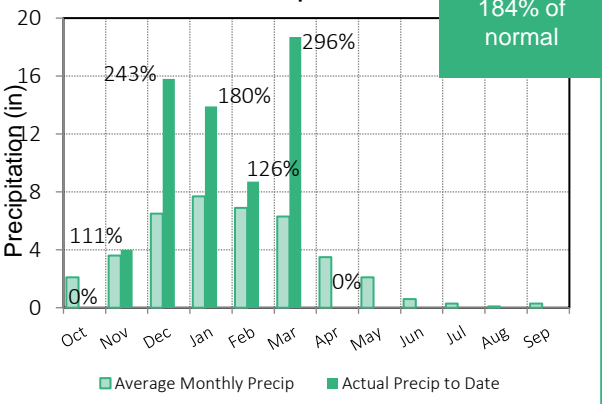


Colorado River Resources

As of: 04/02/2023


Upper Colorado Precipitation

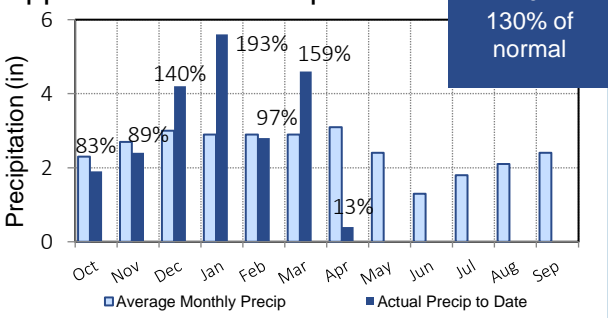


Upper Colorado Snowpack

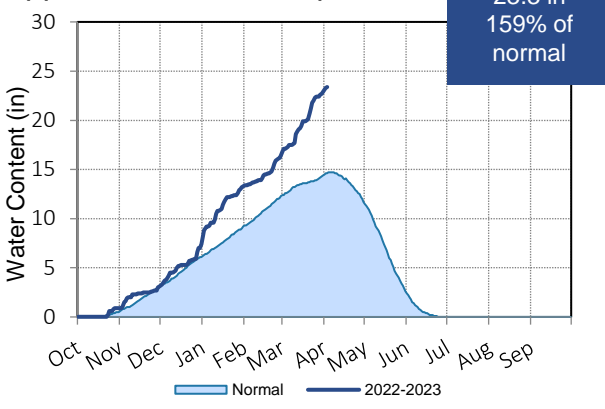


Powell Unregulated Inflow

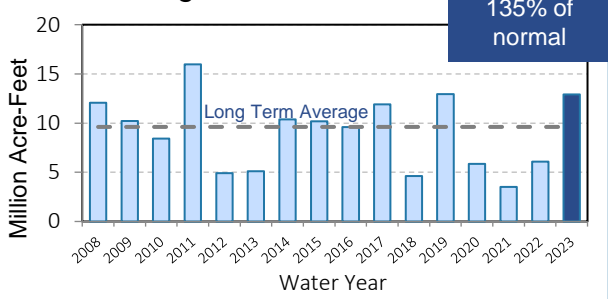

PVID/Yuma Agricultural Use

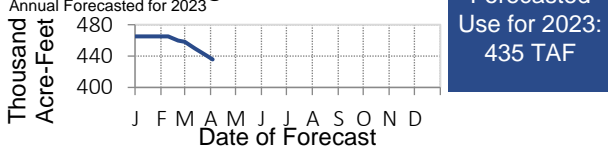

Lake Powell Storage

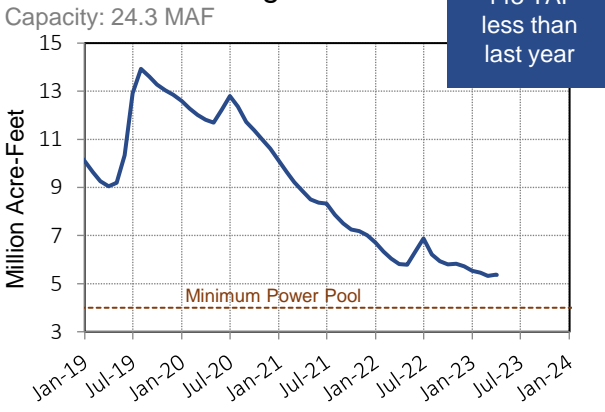

Projected Lake Mead ICS

Calendar Year 2023	
Put (+) / Take (-)	Zero

Lake Mead Surplus/Shortage Outlook

	2023	2024	2025	2026
Surplus	0%	0%	0%	0%
Shortage	100%	93%	93%	93%
Metropolitan	60%	67%	60%	60%
DCP*	250 TAF	263 TAF	278 TAF	

Likelihood based on results from the January 2023 CRMS in Ensemble Model/CRSS model run. Includes DCP Contributions.
* Chance of required DCP contribution by Metropolitan. Volume is average contribution when needed.

Lake Mead Storage

