




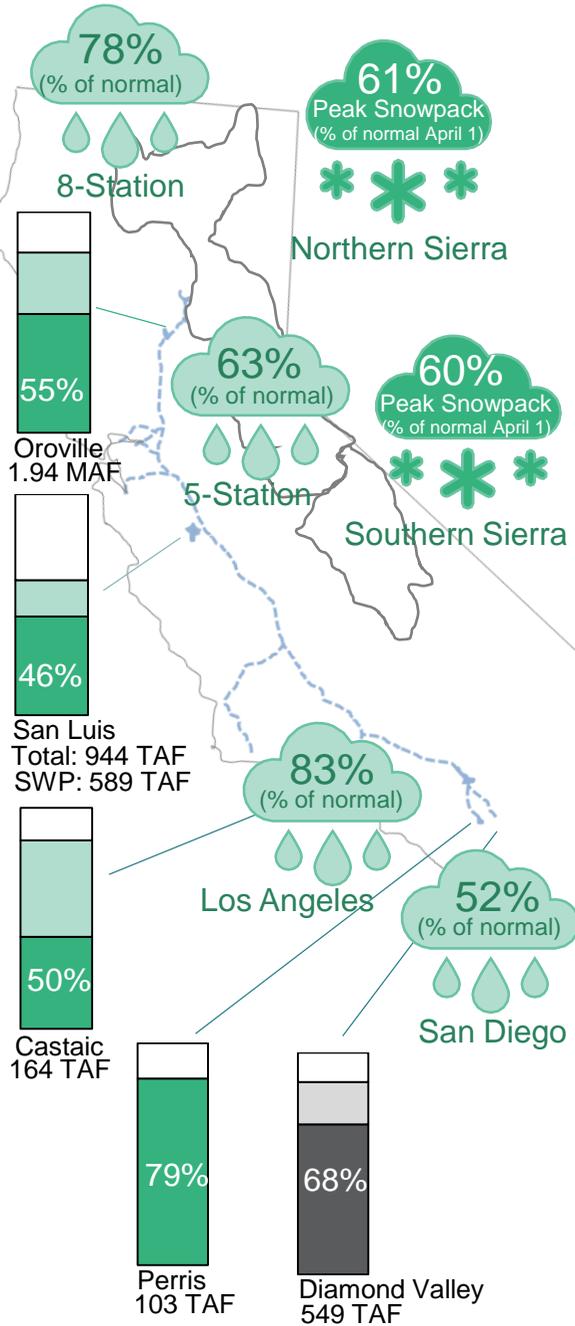

SWP Table A – 5% - 95,575 AF

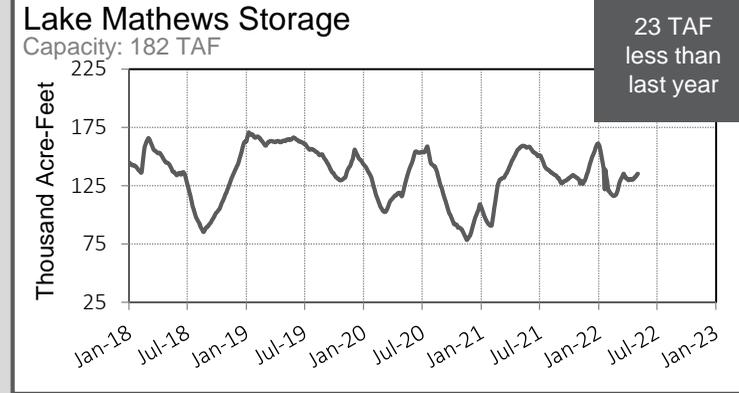


Metropolitan Resources

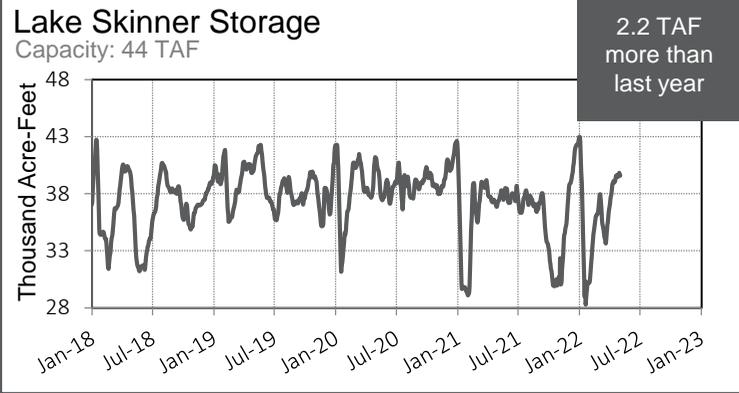


MWD WSDM Storage

Calendar Year 2022

	Take Capacity
Colorado River Aqueduct Delivery System	351 TAF
State Water Project System	185 TAF
In-Region Supplies and WSDM Actions	426 TAF
Other Programs	10 TAF
Total WSDM Storage Take Capacity	972 TAF

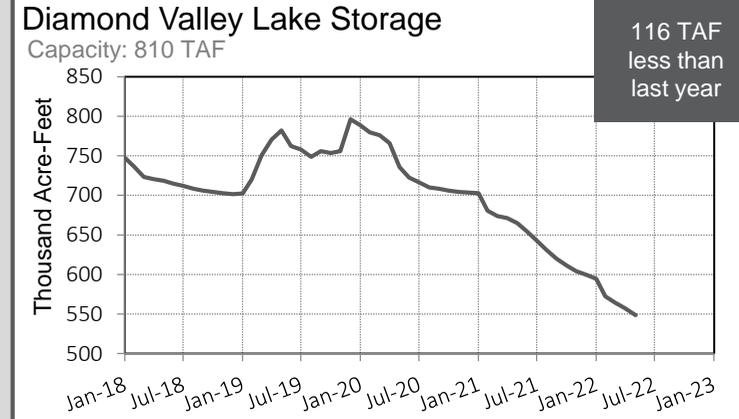

Projected CRA Diversions – 1,135,000 AF

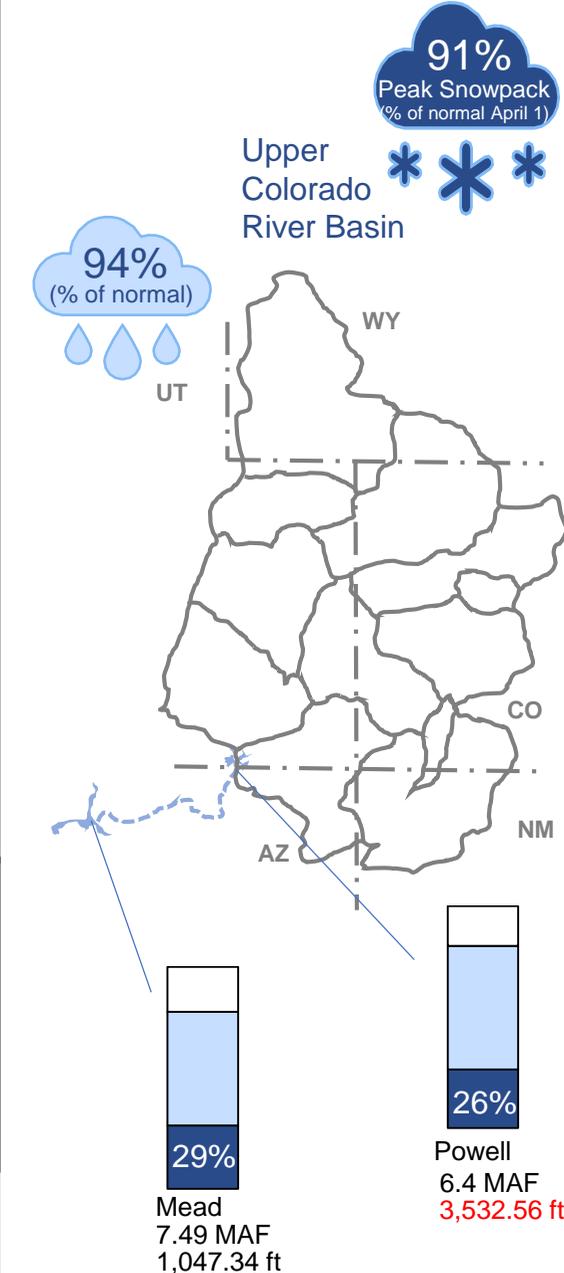

Highlights

- For more information on the current drought:
 - <https://www.mwdh2o.com/planning-for-tomorrow/how-we-plan/drought/>




This report is produced by the Water Resource Management Group and contains information from various federal, state, and local agencies. The Metropolitan Water District of Southern California cannot guarantee the accuracy or completeness of this information. Readers should refer to the relevant state, federal, and local agencies for additional or for the most up to date water supply information. Reservoirs, lakes, aqueducts, maps, watersheds, and all other visual representations on this report are not drawn to scale. Questions? Email mferreira@mwdh2o.com

State Water Project Resources

As of: 06/02/2022


Northern Sierra Snowpack

Peak: 17.2 in
Jan 17, 2022

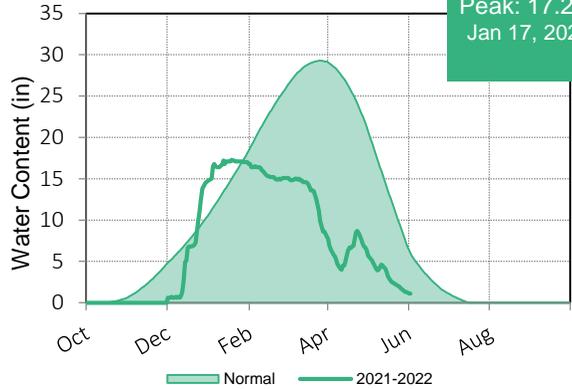

8 Station Index Precipitation


39.6 in
78% of normal

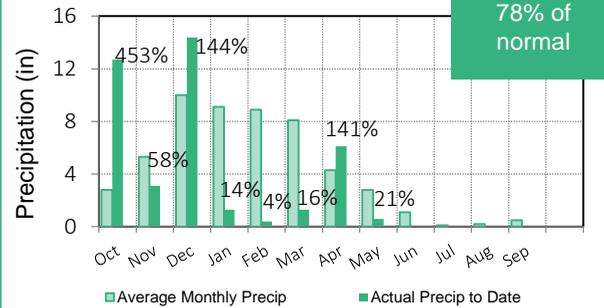

Oroville Reservoir Storage


Capacity: 3.54 MAF

570 TAF
more than last year

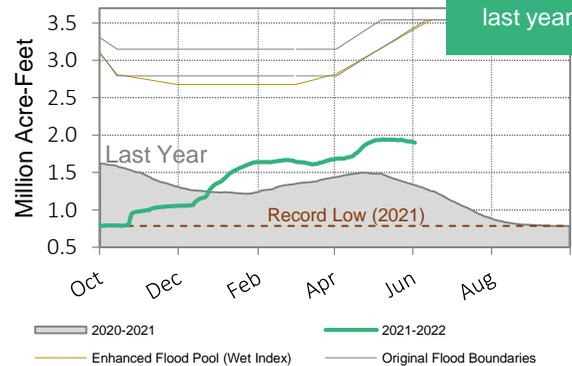

Sacramento River Runoff


Forecast:
59% of normal

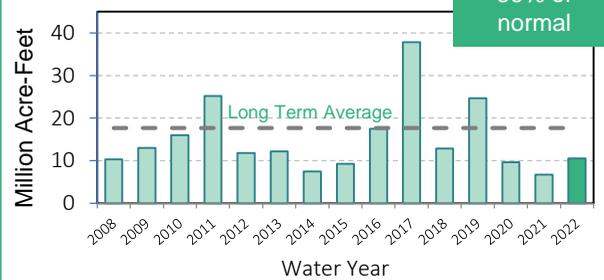

San Luis Reservoir Storage


Capacity: 2.04 MAF

19 TAF less
for SWP than last year

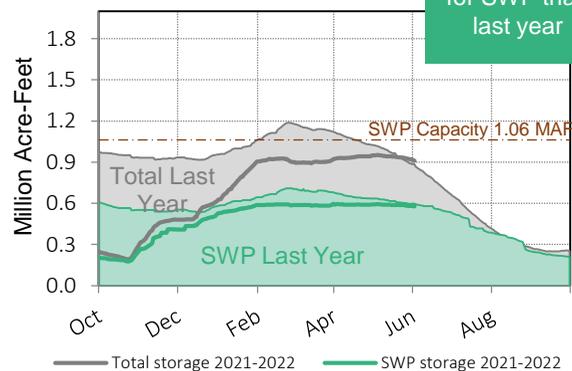

5 Station Index Precipitation

24.3 in
63% of normal

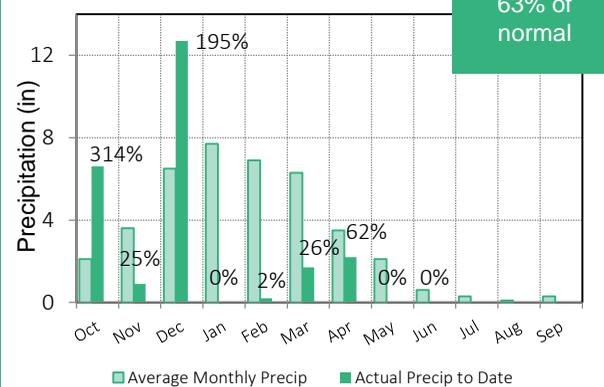


Colorado River Resources

As of: 06/02/2022


Upper Colorado Precipitation

20.8 in
94% of normal

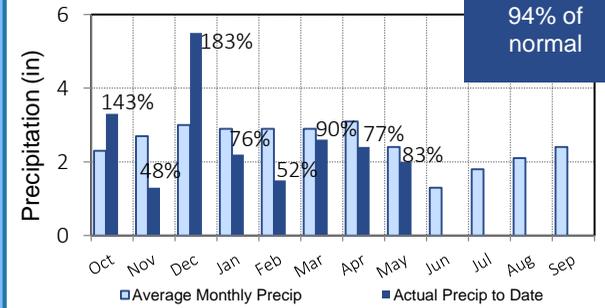


Upper Colorado Snowpack

Peak: 13.3 in
Mar 18, 2022

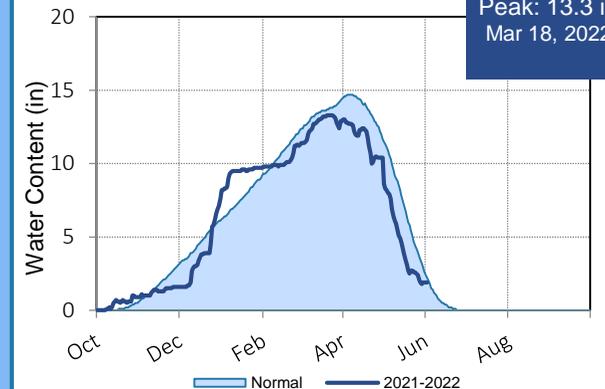

Powell Unregulated Inflow


Forecast:
59% of normal

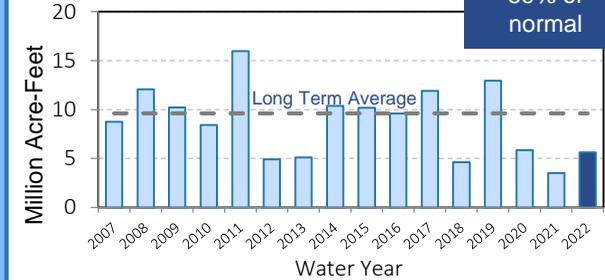

PVID/Yuma Agricultural Use

Annual Forecasted for 2022

Current
Annual
Forecast:
471 TAF

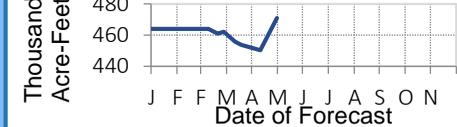

Projected Lake Mead ICS

Calendar Year 2022

Put (+) / Take (-)
-280,000 AF

Lake Mead Surplus/Shortage Outlook

	2022	2023	2024	2025	2026
Surplus	0%	0%	0%	0%	0%
Shortage	100%	100%	93%	100%	87%
Metropolitan DCP*		3% 180 TAF	70% 272 TAF	66% 290 TAF	56% 299 TAF

Likelihood based on results from the May 2022 CRMMs in Ensemble Mode/CRSS model run. Includes DCP Contributions. Only includes 500+ Plan items implemented to date.

* Chance of required DCP contribution by Metropolitan. Volume is average contribution when needed.

Lake Mead Storage

Capacity: 26.1 MAF

1.94 MAF
less than last year

